

SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

No. 262

Dated: 29.12.2025

It is certified that an inspection team headed by the **Asstt. Chief Water Analyst Delhi Jal Board (Govt. of N.C.T Delhi)** Quality Control Laboratory Water Works Nangloi Delhi – 41 in **Holy World School, Arjun Park, Ishwar Colony, New Delhi – 110043** on 29.12.2025 and on the basis of Water Test Report (Attached) bearing no. 262 dated 29.12.2025.

It is certified that **Holy World School, Arjun Park, Ishwar Colony, New Delhi – 110043** has safe drinking water facilities for the students and members of staff of the institution. School is also maintains the hygienic sanitation condition in the school building & the campus as per norms prescribed by the Central U.T. Govt.

This certificate is valid till **28.12.2026 (1 year)**

Signature with Seal
Name: **ACWA**
Designation: **Asstt. Chief Water Analyst**
Name & Address of the Office / Department: **DELHI JAL BOARD**
Govt. of N.C.T. Delhi
Quality Control Laboratory
Water Works Nangloi, Delhi-41

To

Manager / Principal

**Holy World School, Arjun Park,
Ishwar Colony, New Delhi – 110043**

Delhi Jal Board

Water Works Haiderpur

Cash / Draft / CDR

Challan No. 262

Dated: 29.12.2025

Name of Depositor	Description	Amount
PRINCIPAL, HOLY WORLD SCHOOL, ARJUN PARK, ISHWAR COLONY, NEAR NANGLI METRO STATION, PILLAR NO. 69, NEW DELHI-43	02 no. (B+C) water sample test fee for drinking purpose only.	Rs. 1640.00


Junior Assistant

Rs. 1640/- C.B.F. No. 258
G.O. No. DL 29/12/25

OWA (V&S)-II
W.T.P. H.P.



DELHI JAL BOARD
(GOVT. OF N.C.T. DELHI)
QUALITY CONTROL LABORATORY,
WATER TREATMENT PLANT NANGLOI , DELHI-110041



International Year
of Cooperatives

Water Sample Analysis report of samples collected from "Holy World School" Arjun Park, Ishwar Colony, New Delhi-110043 Vide Challan No. 262 Dt-29.12.2025.

S1:- Borewell Water at above site.

S2:- Drinking Point with (R.O.) at above site.

S. No.	Particulars	Units	Limit		S1	S2
			Acceptable	Permissible		
THE TEST REPORT IS FOR THIS PARTICULAR WATER SAMPLE ONLY.						
PHYSICAL EXAMINATION						
1.	Date of collection	-----	--	--	22.01.2026	
2.	Date of Analysis	-----	--	--	24.01.2026	
3.	Colour	CU	5.0	15	Clear	Clear
4.	Odour	-----	No. Objectionable		No Obj.	No Obj.
5.	Turbidity	N.T.U.	1.0	5.0	3.7	1.5
6.	PH value	-----	6.5	8.5	7.38	6.68
7.	Electrical Conductivity	µmho/cm	--	--	4732	85.3
8.	Total dissolved solids	mg/l	500	2000	3075	55.4
CHEMICAL EXAMINATION						
9.	Phenolphthalein Alkalinity	mg/l	--	--	NIL	NIL
10.	Total Alkalinity	mg/l	200	600	415	12
11.	Total Hardness	mg/l	200	600	615	14
12.	Calcium Hardness	mg/l	--	--	205	06
13.	Magnesium Hardness	mg/l	--	--	410	08
14.	Calcium as Ca	mg/l	75	200	82	2.4
15.	Magnesium as Mg	mg/l	30	100	98.4	1.92
16.	Ammonia as N	mg/l	0.5	N.R.	NIL	NIL
17.	Nitrite as N	mg/l	---	--	0.040	NIL
18.	Nitrate as No ₃	mg/l	45	N.R.	38	0.6
19.	Sulphate	mg/l	200	400	390	06
20.	Chloride	mg/l	250	1000	796	22
21.	Fluoride	mg/l	1	1.50	0.58	0.06
22.	Dissoive Iron	mg/l	1	N.R.	0.18	ND
23.	Cyanide	mg/l	0.05	N.R.	ND	ND
24.	Residual Chlorine	mg/l	0.20(min)	1.0	NIL	NIL
BACTERIOLOGICAL EXAMINATION						
25.	Coli-form per 100 ml at 37°C	MPN	0		44	0

REMARKS:- As per tested parameters Samples - S1 found **unsatisfactory** & can not be used for drinking purpose whereas Sample - S2 found **satisfactory** & can used for drinking purpose.


[Signature]
ACWA
Asstt. Chief Water Analyst
DELHI JAL BOARD
Govt. of N.C.T. Delhi
Quality Control Laboratory
Water Works Nangloi, Delhi-41

[Signature]
CHEMIST

[Signature]
A/BACT.



MUNICIPAL CORPORATION OF DELHI
OFFICE OF DEPUTY HEALTH OFFICER
NAJAFGARH ZONE

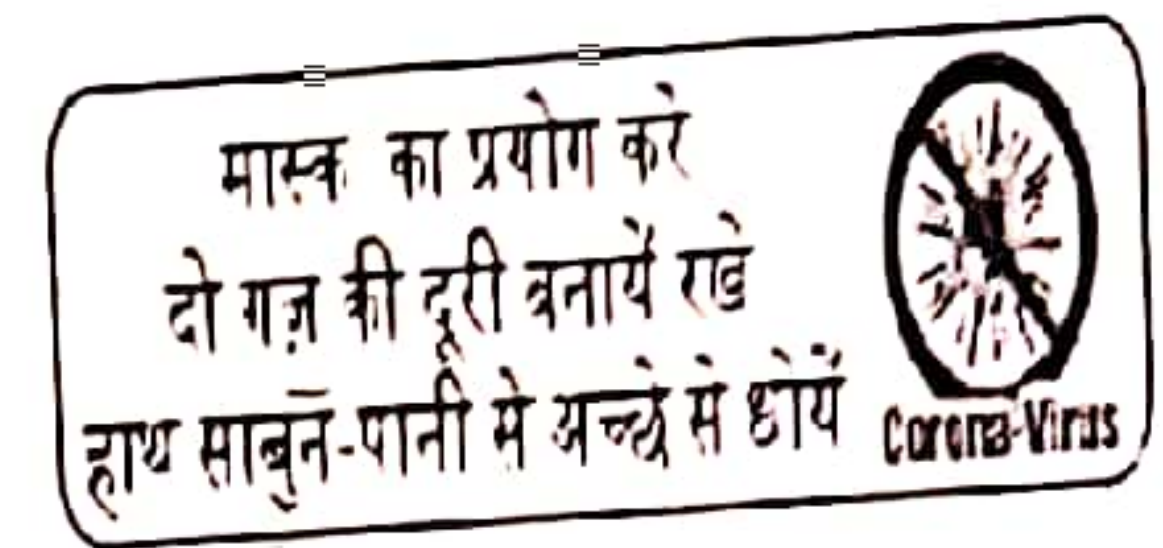

No: DHO/NGZ/MCD/2025/D- 1854

Dated-09/01/2026

SCHOOL HEALTH CERTIFICATE

1. Name of the School: - HOLY WORLD SCHOOL
2. SCHOOL ADDRESS:- Arjun Park, Ishwar Colony, New Delhi 110043
3. NO. OF SHIFT ONE TIMING Morning. 08:00 AM TO 01:30 PM
4. NO. OF STUDENTS: BOYS- 849 GIRLS – 661 TOTAL = 1510
5. NO. OF STAFFS: MALE - 10 FEMALE – 64 TOTAL = 74


Details of Accommodations present in School

- | | |
|---|-------------------------------------|
| 1. Floor Space in the Classroom Sufficient/insufficient | SUFFICIENT |
| 2. The Classrooms are Well Lighted/ill lighted | WELL LIGHTED |
| 3. The Classrooms are Well Ventilated/ill ventilated | WELL VENTILATED |
| 4. The Classrooms are kept / Not kept Neat & Clean: | NEAT AND CLEAN |
| 5. The Building requires/does not required Whitewash etc. | NOT REQUIRED |
| 6. The Drinking Water is Wholesome/Not wholesome | WHOLESOME |
| 7. The Latrine arrangement is Sanitary/Insanitary | SANITARY FROM HEALTH POINT OF VIEW. |

No. of toilets seats for student

1. One latrine-cum-urinal is required for 25 female student, so total is SUFFICIENT
2. One latrine for 40 male student is required so total is SUFFICIENT
3. Separate Toilet arrangement for staff present: Yes/No YES SEPARATE EXISTS FOR STAFF.
4. The Overall facilities: Good/ Adequate/Inadequate GOOD FROM HEALTH POINT OF VIEW.

If building Department or any other govt. agency takes actions against u/a construction or any dispute, then the Health Certificate will be stand cancelled /revoked without any further intimation in this regard

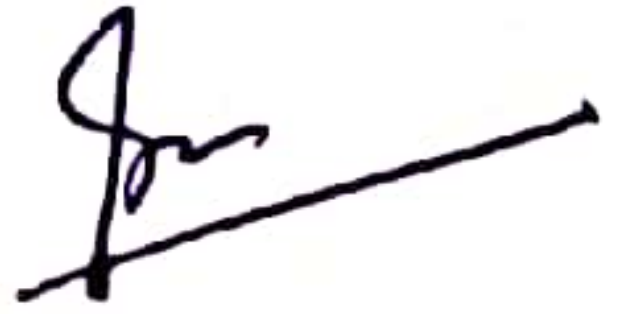
Deputy Health Officer
Najafgarh Zone
Municipal Corporation Of Delhi
Health Deptt., Najafgarh Zone

(Remarks: This Certificate is valid for one year from the date of issue and this has no bearing on any unauthorized construction)

Note:- (This certificate Valid for G+03 upper floors only, as per Fire NOC)